



25mm
3ph+E
80A fuse
DB 4-1
6R 6Y 6B

MAIN
ISOLATOR
DAMPER
OPEN

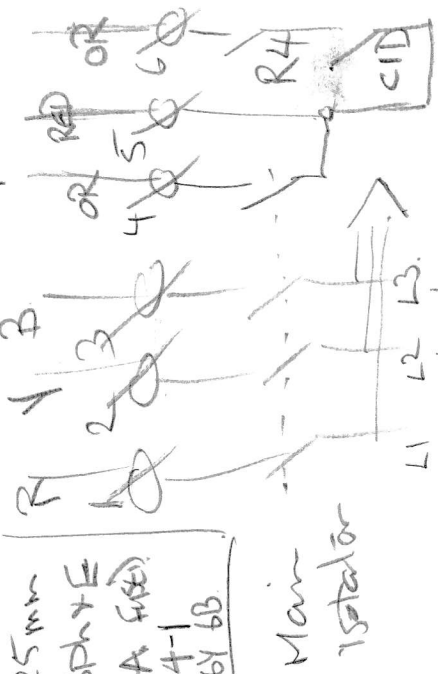


Main
Isolator

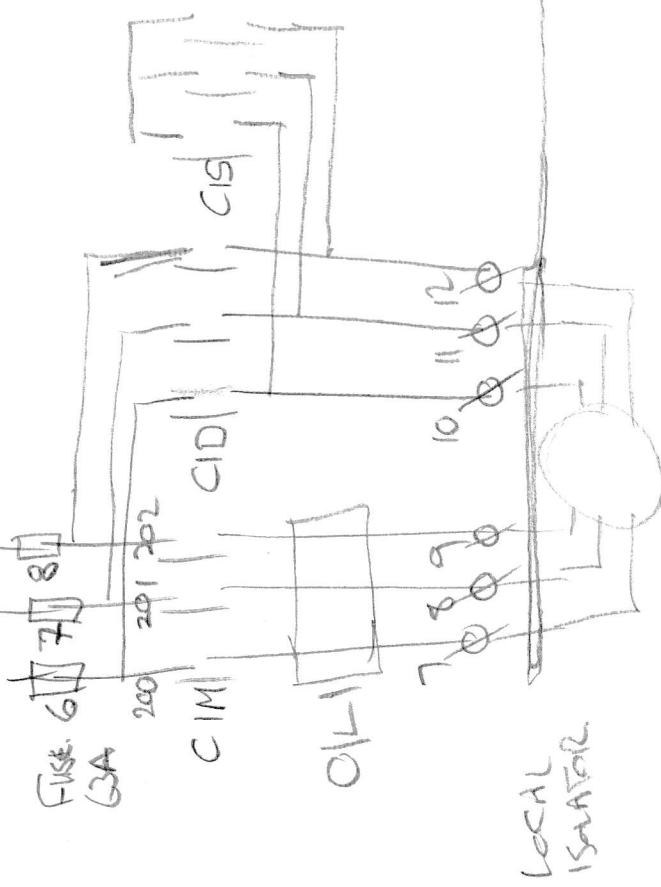

LOCAL
ISOLATOR

Main fan
21 KW

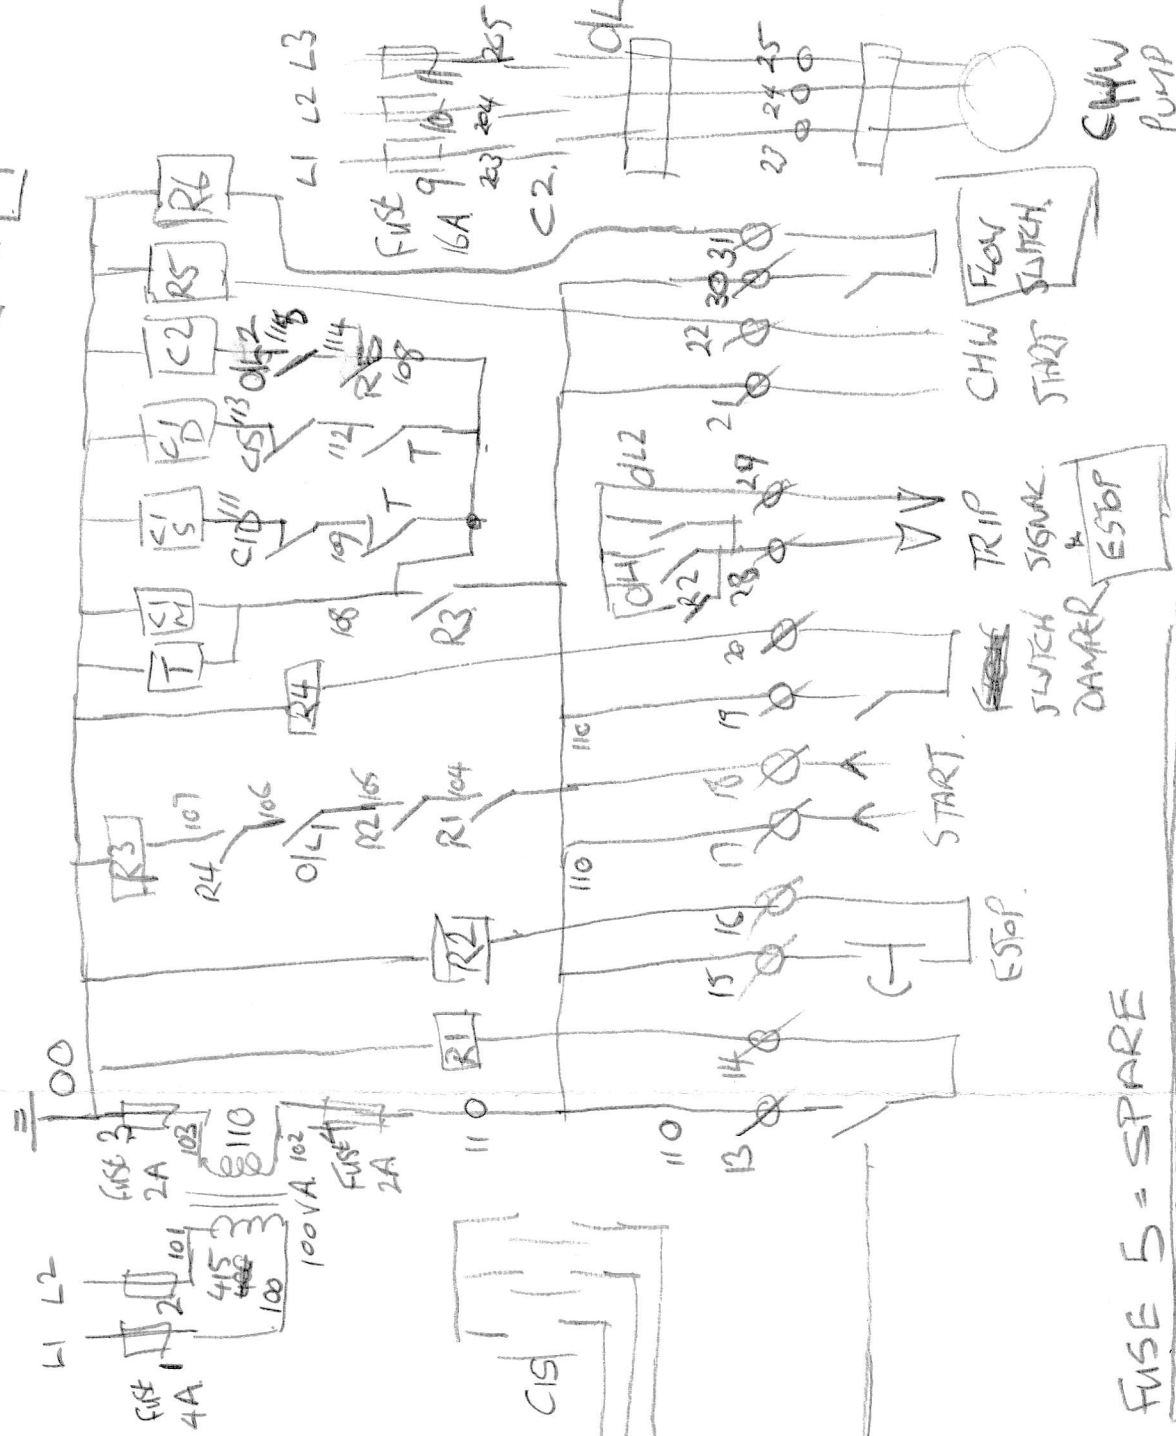

FUSE 5 = SPARE

KLING & BAKER,
LOWER BASEMENT.
LAB AREA EXTRACT FAN

ADDED: R6
TERMS 26/27 BMS FAN RUN (AIR FLOW)
TERMS 30/31 NEW AIR FLOW SWITCH,
TERMS. 28/29 R2 added. (ESTOP.)

RVS 27/10/08

CHW
PUMP
4kW.